


KWP-P

RECTANGULAR FIRE VENTILATION DAMPER



Product characteristics:

A fire ventilation damper for fire ventilation and mixed ventilation systems, with an electric actuator without a return spring.

Intended use

The KWP-P-E fire dampers are used in fire ventilation systems to prevent the spread of fire, heat and smoke.

The KWP-P-E fire dampers are certified by the Building Research Institute (ITB – Instytut Techniki Budowlanej). **Certificate of Constancy of Performance No. 1488-CPR- 0437/W**. The set of dampers has been awarded the National Technical Assessment No. ITB-KOT-2020/1398.

During the normal operation of the system, the isolating baffle of the KWP-P-E dampers is in the open or closed position. In case of fire, the actuating system opens the dampers that operate the fire detection zone (dampers in other zones are closed).

The dampers are designed, manufactured and tested in accordance with the following standards: **PN-EN 12101-8** "Smoke and heat control systems – Part 8: Smoke control dampers" and **PN-EN 13501-4** "Fire classification of construction products and building elements – Part 4: Classification using data from fire resistance tests on components of smoke control systems."

The effectiveness of the dampers is confirmed by tests according to **PN-EN 1366-2 and PN-EN 1366-10** "Fire resistance tests for service installations – Part 2: Fire dampers, Part 10: Smoke control dampers."

The KWP-P-E fire dampers are classified as tightness class C (housing tightness) devices on the basis of tests carried out according to **PN-EN 1751** "Ventilation for buildings. Air terminal devices. Aerodynamic testing of dampers and valves."

Classification

KWP-P-E dampers installed individually:

EI 120 (v_{ew}-h_{ow}-i↔o) S1500C_{10 000} AA multi

EI 120 (v_{ed}-i↔o) S1000C_{10 000} AA multi

KWP-P-E dampers installed in sets:

EI 120 (v_{edw}-i↔o) S1000C_{10 000} AA multi

It means that the automatically controlled damper installed in building partition or in a duct outside the building partition keeps integrity, insulating and smoke leakage properties for at least 120 minutes; the class above also means that the damper may be operated remotely for at least 2 minutes from the moment of receiving the signal from the fire detector.

The KWP fire dampers can be installed in vertical and horizontal building partitions, with either a horizontal or a vertical rotation axis, with any actuator position, or in a duct outside a building partition, with a horizontal rotation axis, with any actuator position.

The dampers may be mounted individually or in sets (16 pcs max., up to 10 m²) in rigid walls or in a duct (shaft).

Description

The damper consists of two housings made of a galvanized metal sheet, separated with insulating separators made of a 40 mm thick fire-rated material. There is a baffle inside the damper. The movement of the baffle into the closed position by means of a set of tie rods is limited by a buffer. The axes of the baffle are embedded by slide bearings in the insulating separators. The baffle is closed by means of a set of tie rods.

The KWP-P-E fire dampers may optionally be equipped with two inspection openings, at the top and at the bottom, thus there is no necessity of installing inspection openings in the ducts close to the dampers in order to carry out periodic inspections and tests. There is also no need to determine the servicing side.

The permissible air velocity in a BxH connection duct for KWP-P-E dampers is 12 m/s.

Manufacturing versions

KWP-P-E – a fire ventilation damper (normally closed or open). The BEN, BEE or BE electric actuators of BELIMO form the drive system. Switching between open and closed position of the damper (and vice versa) takes place after the power supply has been applied to the proper actuator contacts. There are microswitches permanently installed in the actuator for indicating the open/closed position of the damper. The KWP-P-E dampers have no thermal switches, and the electric actuators used in the dampers have no return springs (voltage loss do not cause the movement of the damper isolating baffle).

FIRE VENTILATION ZONE

Conforms to the requirements of: EN 12101-8



The range of the dampers covers the following dimensions: a clear damper width from 200 to 1,500 mm (10 mm intervals) and a clear damper height from 200 to 1,500 mm (10 mm intervals), and is limited to the gross surface area of 1.5 m². Above this size the dampers are manufactured as sets (batteries). The damper batteries are delivered disassembled into single dampers and prepared for assembly on site.

Dimensions

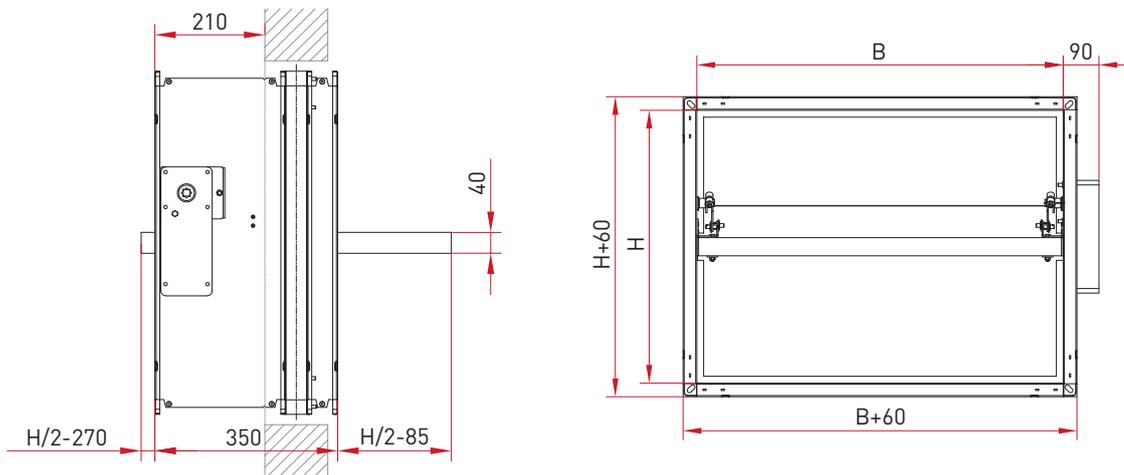


Figure 1. KWP-P-E damper (with an electric actuator without a return spring).



When mounting the damper with an actuator on the opposite side of the body, rotate the damper 180 degrees – cables will go up from the actuator.

Installation

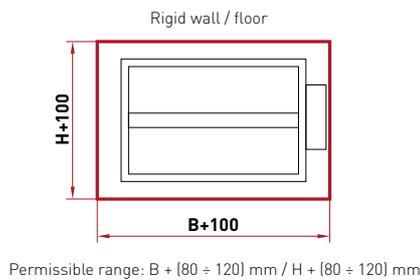


Figure 2. Openings required for the KWP-P damper mounted separately.

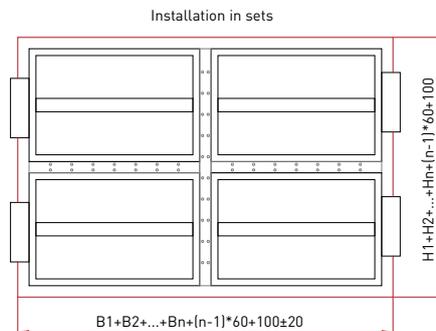


Figure 3. Openings required for the KWP-P dampers installed in sets.

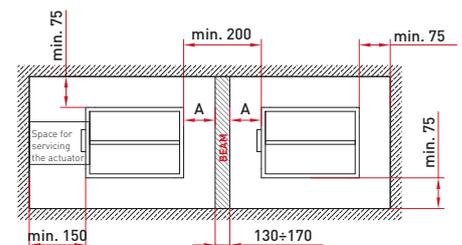


Figure 4. Spacing required between dampers installed individually.

Table 2. Pressure drop on KWP-P damper, Δp [Pa].

KWP-P	v [m/s]	Width B [mm]														
		200	300	400	500	600	700	800	900	1000	1100	1200	1300	1400	1500	
Height H [mm]	200	4	12	12	10	10	10	10	8	-	-	-	-	-	-	-
		6	25	25	22	22	22	22	20	-	-	-	-	-	-	-
		8	45	46	40	40	40	40	38	-	-	-	-	-	-	-
		10	68	68	60	60	60	60	56	-	-	-	-	-	-	-
	300	4	8	8	7	7	7	7	7	7	6	5	5	-	-	-
		6	18	18	15	15	15	15	15	15	13	11	11	-	-	-
		8	32	32	27	27	27	27	27	27	24	22	22	-	-	-
		10	48	48	41	41	41	41	41	41	35	30	30	-	-	-
	400	4	7	7	6	6	6	5	5	5	5	5	5	5	5	4
		6	15	15	13	13	13	11	11	11	11	11	11	11	11	9
		8	27	27	24	24	24	20	20	20	20	20	20	20	20	17
		10	41	41	35	35	35	30	30	30	30	30	30	30	30	26
	500	4	7	7	6	5	5	5	5	4	4	4	4	4	4	4
		6	14	13	13	11	11	11	11	9	9	9	9	9	9	9
		8	25	24	24	20	20	20	20	16	16	16	16	18	18	18
		10	38	35	35	30	30	30	30	24	24	24	24	24	24	24
	600	4	7	6	5	5	4	4	4	4	3	3	3	3	4	4
		6	14	13	11	11	9	9	9	9	7	7	7	7	9	9
		8	26	24	20	20	16	16	16	16	12	12	12	14	18	18
		10	40	35	30	30	24	24	24	24	18	18	18	18	24	24
	700	4	-	5	5	4	4	4	3	3	3	3	3	3	3	3
		6	-	11	11	9	9	9	7	7	7	7	7	7	7	7
		8	-	20	20	16	16	16	12	12	12	12	12	14	14	14
		10	-	30	30	24	24	24	18	18	18	18	18	18	18	18
	800	4	-	5	5	4	4	4	3	3	3	3	3	2	3	3
		6	-	11	11	9	9	9	7	7	7	7	7	5	7	7
		8	-	20	20	16	16	16	12	12	12	12	12	10	14	14
		10	-	30	30	24	24	24	18	18	18	18	18	12	18	18
	900	4	-	5	4	4	4	3	3	3	3	3	2	2	2	2
		6	-	11	9	9	9	7	7	7	7	7	5	5	5	5
		8	-	20	16	16	16	12	12	12	12	12	8	10	10	10
		10	-	30	24	24	24	18	18	18	18	18	12	12	12	12
	1000	4	-	-	4	4	3	3	3	3	3	2	2	2	2	2
		6	-	-	9	9	7	7	7	7	7	5	5	5	5	5
		8	-	-	16	16	12	12	12	12	12	8	8	10	10	10
		10	-	-	24	24	18	18	18	18	18	12	12	12	12	12
	1100	4	-	-	4	3	3	3	3	3	3	2	2	2	-	-
		6	-	-	9	7	7	7	7	7	7	5	5	5	-	-
		8	-	-	16	12	12	12	12	12	12	8	8	10	-	-
		10	-	-	24	18	18	18	18	18	18	12	12	12	-	-
1200	4	-	-	3	3	3	3	3	3	2	2	2	-	-	-	
	6	-	-	7	7	7	7	7	7	5	5	5	-	-	-	
	8	-	-	12	12	12	12	12	12	8	8	8	-	-	-	
	10	-	-	18	18	18	18	18	18	12	12	12	-	-	-	
1300	4	-	-	-	3	3	3	2	2	2	2	-	-	-	-	
	6	-	-	-	7	7	7	5	5	5	5	-	-	-	-	
	8	-	-	-	12	12	12	8	8	8	8	-	-	-	-	
	10	-	-	-	18	18	18	12	12	12	12	-	-	-	-	
1400	4	-	-	-	3	2	2	2	2	2	-	-	-	-	-	
	6	-	-	-	7	5	5	5	5	5	-	-	-	-	-	
	8	-	-	-	12	8	8	8	8	8	-	-	-	-	-	
	10	-	-	-	18	12	12	12	12	12	-	-	-	-	-	
1500	4	-	-	-	2	2	2	2	2	2	-	-	-	-	-	
	6	-	-	-	5	5	5	5	5	5	-	-	-	-	-	
	8	-	-	-	8	8	8	8	8	8	-	-	-	-	-	
	10	-	-	-	12	12	12	12	12	12	-	-	-	-	-	

v [m/s] - air flow velocity in the BxH connection duct

Table 3. Sound power level emitted by the KWP-P damper to the duct, L_{WA} [dB_A].

KWP-P	v [m/s]	Width B [mm]														
		200	300	400	500	600	700	800	900	1000	1100	1200	1300	1400	1500	
Height H [mm]	200	4	13	16	19	20	21	22	23	-	-	-	-	-	-	-
		6	21	24	27	28	30	30	32	-	-	-	-	-	-	-
		8	30	33	35	37	38	39	41	-	-	-	-	-	-	-
		10	38	41	43	45	46	47	49	-	-	-	-	-	-	-
	300	4	17	20	23	24	26	27	28	29	29	30	31	-	-	-
		6	25	29	31	32	34	35	36	37	37	38	40	-	-	-
		8	34	37	39	41	42	43	44	45	46	47	48	-	-	-
		10	42	45	47	49	50	51	52	53	54	55	57	-	-	-
	400	4	20	23	25	27	28	29	30	31	32	32	33	34	35	35
		6	28	31	33	35	36	38	39	39	40	41	41	42	43	43
		8	36	40	42	43	45	46	47	47	48	49	49	50	51	52
		10	45	48	50	51	53	54	55	55	56	57	57	58	59	59
	500	4	22	25	27	29	30	31	32	33	34	34	35	36	37	38
		6	30	33	35	37	38	39	40	41	42	43	43	44	44	46
		8	37	41	44	45	46	48	48	49	50	51	51	52	51	53
		10	45	49	52	53	54	56	56	57	58	59	59	59	60	61
	600	4	23	26	28	30	31	33	33	34	35	36	36	37	39	39
		6	31	34	37	38	40	41	42	43	44	44	45	45	45	48
		8	40	43	45	47	48	49	50	51	51	52	53	53	53	55
		10	48	51	53	55	56	57	58	59	59	60	61	60	60	63
	700	4	-	28	30	31	33	34	35	36	36	37	38	38	40	40
		6	-	36	38	40	41	42	43	44	45	45	46	46	46	49
		8	-	44	46	48	49	50	51	52	53	53	54	54	54	56
		10	-	52	54	56	57	58	59	60	60	61	62	61	62	64
	800	4	-	29	31	32	34	35	36	37	37	38	39	39	41	41
		6	-	37	39	41	42	43	44	45	46	46	47	47	47	50
		8	-	45	47	49	50	51	52	53	54	54	55	55	55	57
		10	-	53	55	57	58	59	60	61	61	62	63	62	63	65
	900	4	-	29	31	33	34	36	37	37	38	39	40	40	42	42
		6	-	38	40	42	43	44	45	46	47	47	48	48	48	51
		8	-	46	48	50	51	52	53	54	54	55	56	56	56	58
		10	-	54	56	58	59	60	61	62	62	63	64	63	64	66
	1000	4	-	-	33	34	36	37	37	38	39	40	41	41	43	43
		6	-	-	41	42	44	45	46	47	47	48	49	49	49	52
		8	-	-	49	50	52	53	54	54	55	56	57	57	57	60
		10	-	-	57	58	60	61	62	62	63	64	65	65	66	67
	1100	4	-	-	33	35	37	38	38	39	40	41	42	42	-	-
		6	-	-	42	43	45	46	46	47	48	49	50	50	-	-
		8	-	-	50	51	53	54	54	55	56	57	58	58	-	-
		10	-	-	58	59	61	62	62	63	64	65	66	66	-	-
1200	4	-	-	34	36	38	39	39	40	41	42	43	-	-	-	
	6	-	-	43	44	46	47	47	48	49	50	51	-	-	-	
	8	-	-	51	52	54	55	55	56	57	58	59	-	-	-	
	10	-	-	59	60	62	63	63	64	65	66	67	-	-	-	
1300	4	-	-	-	37	39	40	40	41	42	43	-	-	-	-	
	6	-	-	-	44	46	47	47	48	49	50	-	-	-	-	
	8	-	-	-	52	54	55	55	56	57	58	-	-	-	-	
	10	-	-	-	60	62	63	63	64	65	66	-	-	-	-	
1400	4	-	-	-	37	39	40	40	41	42	-	-	-	-	-	
	6	-	-	-	45	47	48	48	49	50	-	-	-	-	-	
	8	-	-	-	54	56	57	57	58	59	-	-	-	-	-	
	10	-	-	-	61	63	64	64	65	66	-	-	-	-	-	
1500	4	-	-	-	38	40	41	41	42	43	-	-	-	-	-	
	6	-	-	-	46	48	49	49	50	51	-	-	-	-	-	
	8	-	-	-	54	56	57	57	58	59	-	-	-	-	-	
	10	-	-	-	62	64	65	65	66	67	-	-	-	-	-	

v [m/s] - air flow velocity in the BxH connection duct

Table 4. Weight of KWP-P-E damper, m [kg].

KWP-P-E		Width B [mm]													
		200	300	400	500	600	700	800	900	1000	1100	1200	1300	1400	1500
Height H [mm]	200	12,4	14,6	16,8	19,0	21,2	23,4	25,6	-	-	-	-	-	-	-
	300	14,4	17,0	19,7	22,2	24,9	27,5	30,1	32,7	35,4	38,0	40,6	-	-	-
	400	16,6	19,6	22,6	25,6	28,6	31,6	34,7	37,7	40,7	43,8	46,8	55,2	58,6	61,9
	500	18,7	22,1	25,6	29,0	32,4	35,8	39,3	42,7	46,1	49,5	52,9	62,2	65,9	69,6
	600	20,7	24,6	28,5	32,2	36,1	39,9	43,8	47,6	51,4	55,2	59,1	69,0	73,2	77,3
	700	-	27,1	31,4	35,5	39,8	44,0	48,3	52,5	56,7	61,0	65,2	75,9	80,4	85,0
	800	-	29,6	34,3	38,8	43,5	48,1	52,8	57,4	62,1	66,7	71,3	82,8	87,7	92,7
	900	-	32,1	37,1	42,1	47,2	52,2	57,3	62,3	67,4	72,4	77,5	89,6	96,2	101,5
	1000	-	-	40,1	45,5	51,0	56,4	61,9	67,4	72,8	78,2	83,7	97,8	103,6	109,3
	1100	-	-	43,2	48,9	54,8	60,7	66,5	72,4	78,2	84,1	90,2	104,6	-	-
	1200	-	-	46,2	52,3	58,7	64,9	71,1	77,5	83,7	90,0	104,5	-	-	-
	1300	-	-	-	61,6	68,6	75,6	82,6	89,6	97,8	104,4	-	-	-	-
	1400	-	-	-	65,3	72,8	80,1	87,5	96,2	103,6	-	-	-	-	-
	1500	-	-	-	69,0	76,9	84,7	92,5	101,5	109,3	-	-	-	-	-

KWP-P - Rectangular fire ventilation damper

When ordering, please provide information in accordance with the following pattern:

KWP-P-<F> - x <H> - <L> - <S> - <M> - <Q> - <P> - <RAL>

Where:

F	type of the actuation system used	
	E - electric actuator without a return spring	
B	damper clear width [mm]	
H	damper clear height [mm]	
L	damper length in mm, 350 by default (600 mm optionally)	
S	type of actuator used	
	BEN - for BxH ≤ 1,21 m ² and H ≤ 1100 mm	Product marking: 24/230 – supply voltage ST – connection socket
	BEE - for 1,21 m ² < BxH ≤ 1,30 m ² and H ≤ 1200 mm	
	BE - for BxH > 1,30 m ² or H > 1200 mm	
M	installation in sets*	
	none - installation in sets not possible	
	M - damper adapted to installation in sets	
Q	inspection opening*	
	none - no inspection opening	
	R - inspection opening	
P	finishing*	
	none - galvanized steel	
	SL - coated steel	
RAL	colour as per RAL code (for SL finishing)*	

* optional items – if not indicated, default values will be used

Sample product marking: **KWP-P-E-600x400-350-BEN24**